



# ELXC SERIES

ITEM NO. \_\_\_\_\_

## MODEL "ELXC-BBC-CL"

HIGH EFFICIENCY EXTRACTOR VENTILATOR  
WITH CLEAN-IN-PLACE TECHNOLOGY

### GENERAL SPECIFICATIONS AND DESCRIPTION

Furnish Gaylord Ventilator Model "ELXC-BBC-CL-\_\_\_\_\_" as shown on plans and in accordance with the following specifications:

**HIGH EFFICIENCY EXTRACTION:** Each ventilator shall contain "XGS" High Efficiency Extractors utilizing the "capture and drain" principle. Extractor efficiencies shall be determined using ASTM F2519-2005 testing procedures as accepted by ASHRAE TC 5.10 and ASHRAE Standard 154-2011 - 4.7.2. The "capture and drain" principle shall prevent water from entering the plenum and duct areas during "FAN ON" wash cycles, thus providing 24/7 operators the full effect of clean-in-place technology. The High Efficiency Extractors shall not exceed 55 db, on typical cooking lines, as measured at the chef's ear so fatigue is minimized and productivity is optimized.

**HOOD CONTROLS:** Ventilator incorporates canopy mounted RTD's positioned strategically across the length of the hood to produce a contact closure to react to cooking activity to comply with IMC.

**CAPTURE AND CONTAINMENT:** Each ventilator shall achieve capture and containment using the lowest possible airflow rates through "passive" versus "active" design features, thus eliminating the wiring or adjustment of internal motors, plenums or jets. The ventilator shall include an integrated capture wall to achieve its airflow rates. The lowest possible airflow rates shall be tested to ASTM 1704-09 by the Food Service Technology Center and published on their website for easy confirmation.

<http://www.fishnick.com/publications/appliancereports/hoods/>


**CLEAN-IN-PLACE WASH TECHNOLOGY:** Each ventilator shall include two full length stainless steel wash manifolds with brass nozzles; one to power wash the inlet face and internal passages of the extractors during "FAN ON" mode and one to wash the plenum chamber, during the "FAN OFF" mode as programmed by the Gaylord Command Center. Each wash manifold on each ventilator section shall operate independently so wash cycles may be programmed at different frequencies and different durations to reduce water and detergent usage and optimize cleaning efficacy according to load and demand. Each ventilator section shall drain to sloping gutters with 2" outlets.

**CONSTRUCTION:** Each ventilator shall include full length access panels that are non-tool entry, non-gasketed and non-removable to ease inspection of extractors, plenum and fire extinguishing system. The ventilator shall be of all stainless steel construction, not less than 18 gauge, type 300 series. All exposed surfaces shall be a number 4 finish. The use of aluminized steel or galvanized steel is not acceptable. The Ventilator shall include a "V" bank arrangement of "XGS" High Efficiency Extractors. The Ventilator shall include a static pressure port in each section to be used in balancing exhaust air volumes. Continuous front and rear mounting brackets shall be provided to facilitate mounting to the wall and hanging from the overhead building structure. Each duct collar shall include as standard a Gaylord Balancing Damper (GBD) with opposed blades that adjust manually through access from within the canopy. Ventilators built in end-to-end multiple sections shall have as standard "Continuous Capture" from one end to the other to ease cleaning and improve capture and containment.

**LIGHT FIXTURES:** The ventilator shall be equipped with:

- |  |                   |
|--|-------------------|
| <input type="checkbox"/> Recessed LED                          | 6 Watts/Ft. Min.  |
| <input type="checkbox"/> Recessed fluorescent                  | 12 Watts/Ft. Min. |
| <input type="checkbox"/> 100 watt surface mounted incandescent | 24 Watts/Ft. Min. |
| <input type="checkbox"/> 150 watt recessed incandescent        | 36 Watts/Ft. Min. |

Light fixtures shall be factory pre-wired to a single connection point. Ventilators built in multiple sections shall be furnished with coiled flex conduit for interconnecting sections.

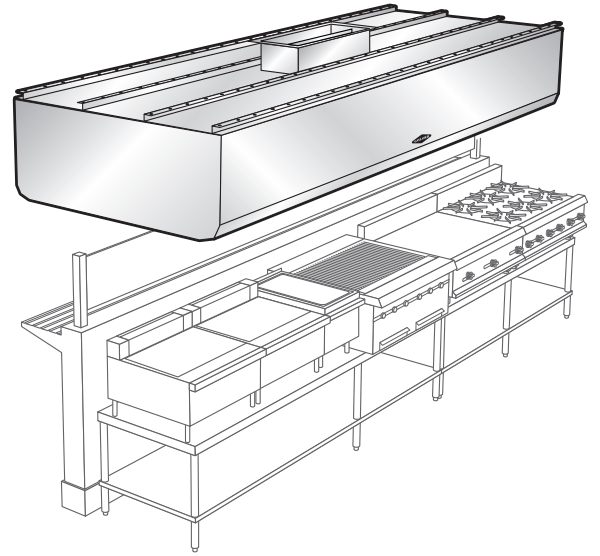

### APPLICATION

Wall mounted canopy for use over all types of equipment; ovens, broilers, griddles, fryers, ranges, steam equipment, etc.

### DESIGN FEATURES

- Demand Control Autostart
- Internal Canopy Radius
- Enhanced "XGS" Extractor Angle and Slot Spacing
- Faceted "Super Capture"™ Lip
- Integrated Capture Wall

### OPTIONAL EQUIPMENT



1. Decorative Facings and Trim
2. Demand Control Ventilation
3. Fire Extinguishing Systems
4. Pollution Control Systems
5. Utility Distribution Systems
6. "XGS" Spark Arrestor Extractors

**ACCEPTANCE & APPROVALS:** Each ventilator shall include an integral listed Demand Control Autostart fan equipment interlock complying with IMC (optional outside North America). Each ventilator shall be Listed to UL Standard 710, ULC S646 and NSF/ANSI 2, comply with all requirements of NFPA-96, IMC, UMC, BOCA, and SBCCI standards with XGS High Efficiency Extractors tested to ASTM 2519-2005.



## GAYLORD INDUSTRIES

10900 SW AVERY ST • TUALATIN, OREGON 97062 U.S.A.  
PHONE: 800.547.9696 • FAX: 503.692.6048 • email: info@gaylordventilation.com  
[www.gaylordventilation.com](http://www.gaylordventilation.com)

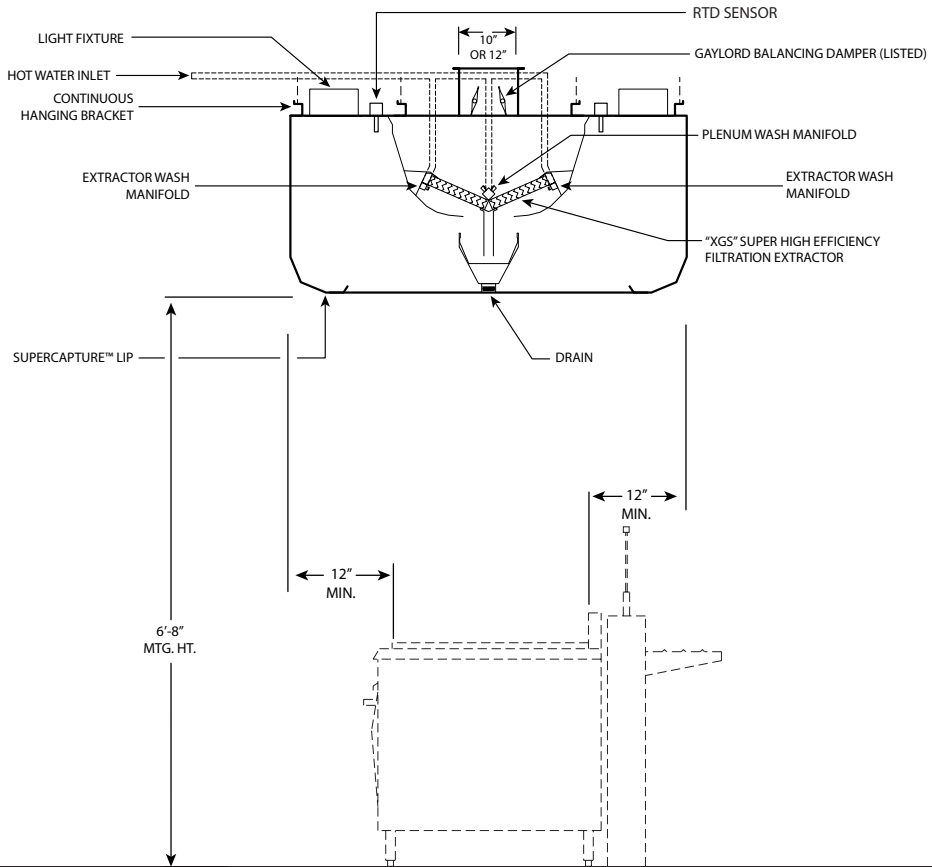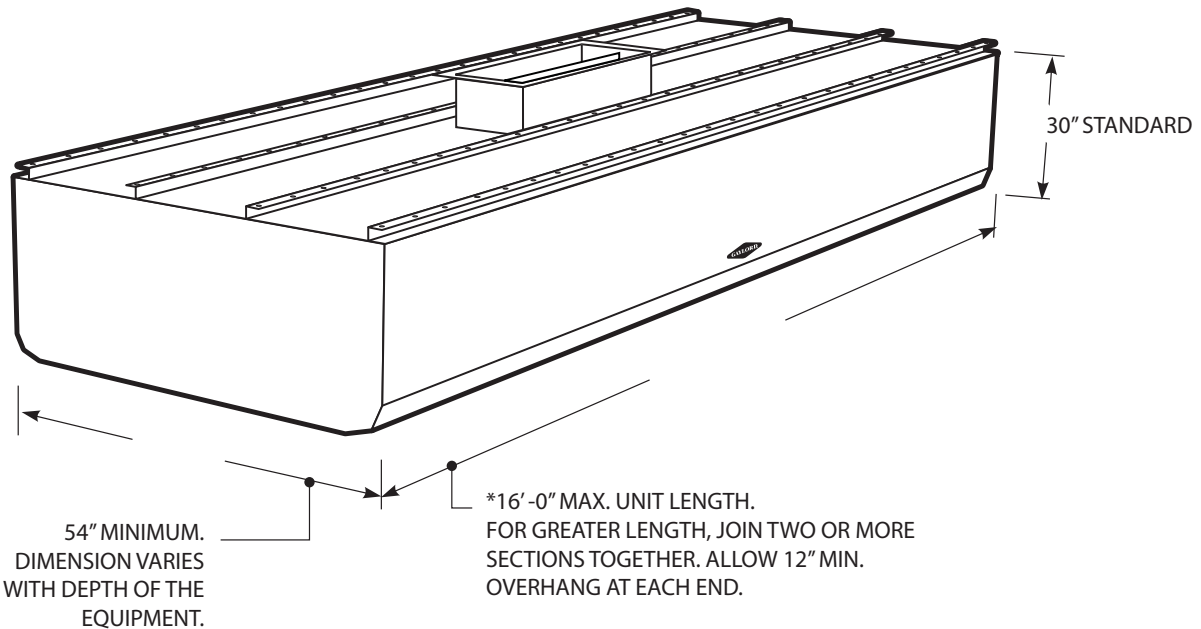

**ENGINEERING DATA**

**Mechanical Requirements**

The amount of exhaust volume required is dependent upon the type of cooking equipment and the type and volume of cooking. Contact factory for exhaust volumes, duct sizes, and static pressures.

**Electrical**

Provide 120 volt 50/60Hz circuit to lights, 220/240 volt optional. Refer to Wash Control Cabinet for its electrical requirements.

**Ventilator Lengths**

Maximum unit length 16'-0". For greater lengths, join two or more sections together. Check to ensure that there is adequate access into building and kitchen area.

**\*Note:** Ventilators manufactured outside North America; maximum unit length 10'-0".

**Hanging Weight**

Ventilator Width	54"	60"	66"
Wt. / Lineal Ft.	Lbs. 100	105	110

The manufacturer reserves the right to modify the materials and specifications resulting from a continuing program of product improvement or the availability of new materials